

A2 EMC

COMPRESSION GLAND

for Braided and Copper Tape Cable




Features and Benefits

- For indoor and outdoor use.
- Seals the cable sheath to IP66/68. Specially formulated elastomeric seals.
- Provides 360° earthing.
- Precision manufactured from high-quality brass (nickel plated), available in aluminium or stainless steel 316/316L on request.
- Complete with a heavy-duty locknut.
- Complete with a thread sealing gasket.



Technical Data

Type:	A2 EMC	
Gland Material:	Brass (Nickel Plated) BS 2874, EN 12164, Aluminium ASTM BS221 or Stainless Steel 316/316L	
Seal Material:	Thermoset Elastomer or Silicon on request.	
Cable Type:	Braided, Copper Tape	
Sealing Area:	Outer Sheath	
Optional Accessories:	Adaptor, Reducer, Earth Tag, Locknut, Serrated Washer and Shroud	
Standards and Certifications		
Mechanical Properties:	Impact Category 8 Anchorage Type B	
Continuous Operating Temp:	-65°C to +120°C	
Conformance:	Standard:	Certificate:
Design Standards	BS 6121:Part 1 EN 50262 IEC/BS EN 62444 SANS 62444 SANS 1213	CML 14CA364 CML 14CA364 CML 14CA364 MASC 22-9012 MASC 26-9013 2109/4596 CML 15Y728, MASC 22-9015
IP66/68 100m - Parallel	IEC 60529	
IP65 - Tapered	IEC 60529	
Marine ABS	IEC 60529, IEC 62444	25-0167207-PDA
DNV	IEC 60529, BS 6121, IEC 62444	TAE000000Z
EMC Compatible	EN 55011, + A1, EN 55022	SGS EMC305079/1
London Underground Approval	BS EN 62444	LU 3043

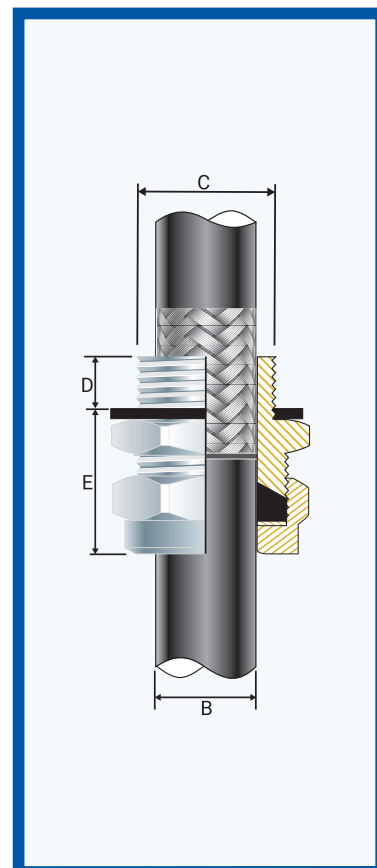

Installation Standards


- AS/NZS 3000
- BS 7430
- BS 6121-5
- IEC 60364-5-54
- BS 7671
- SANS 0142

Product Code	Gland Size Reference	Metric Entry Thread		NPT Entry Thread		Cable Detail		Maximum Length 'E'	Hexagonal Detail		Installation Torque Value Nm
		'C'	Min 'D'	'C'	Min 'D'	Min 'B'	Max 'B'		Max 'Flats'	Max 'Crns'	
053500-16S-EMC	00-16S	M16x1.5	10	-	-	1.0	6.0	20.0	18.0	20.0	20.0
053500-16-EMC	00-16ss	M16x1.5	10	-	-	3.0	8.5	20.0	24.0	27.0	32.5
053500-EMC	00-20ss	M20x1.5	10	1/2/3/4	15	3.0	8.5	20.0	24.0	27.0	32.5
0535-0-EMC	0-20s	M20x1.5	10	1/2/3/4	15	7.0	11.5	20.0	24.0	27.0	32.5
053501-EMC	1-20	M20x1.5	10	1/2/3/4	15	11.0	15.0	24.0	27.0	30.0	32.5
053522-EMC	2s-25s	M25x1.5	10	3/4/1	15/19	11.5	17.5	25.0	35.0	39.0	47.5
053502-EMC	2-25	M25x1.5	10	3/4/1	15/19	15.0	20.0	25.0	35.0	39.0	47.5
053533-EMC	3s-32s	M32x1.5	10	1/1 1/4	19	16.0	22.0	30.0	42.0	47.0	55.0
053503-EMC	3-32	M32x1.5	10	1/1 1/4	19	20.0	26.5	30.0	42.0	47.0	55.0
053544-EMC	4s-40s	M40x1.5	15	1 1/4/1 1/2	19/21	22.0	31.5	30.0	52.0	59.0	65.0
053504-EMC	4-40	M40x1.5	15	1 1/4/1 1/2	19/21	26.0	34.0	30.0	52.0	59.0	65.0
053555-EMC	5s-50s	M50x1.5	15	1 1/2	21	29.0	38.0	42.0	65.0	73.0	82.5
053505-EMC	5-50	M50x1.5	15	2	21	34.0	44.5	42.0	65.0	73.0	82.5
053566-EMC	6s-63s	M63x1.5	15	2	21	38.0	50.0	48.0	80.0	90.0	97.5
053506-EMC	6-63	M63x1.5	15	2 1/2	30	44.5	56.5	48.0	80.0	90.0	97.5
053577-EMC	7s-75s	M75x1.5	15	2 1/2	30	50.0	62.0	50.0	96.0	102.0	115.0
053507-EMC	7-75	M75x1.5	15	3	32	56.0	67.5	50.0	96.0	102.0	115.0
053588-EMC	8s-80s	M80x2.0	20	3	32	54.0	69.0	55.0	96.0	102.0	120.0
053508-EMC	8-80	M80x2.0	20	3	32	65.0	74.0	55.0	96.0	102.0	120.0
053599-EMC	9s-90s	M90x2.0	20	3	32	60.0	75.0	60.0	111.0	125.0	120.0
053509-EMC	9-90	M90x2.0	20	3 1/2	33	73.0	81.5	60.0	111.0	125.0	120.0
053510-EMC	10-100	M100x2.0	20	3 1/2/4	33/34	81.0	91.0	74.0	-	-	120.0
053511-EMC	11-110	M110x2.0	20	4	34	91.0	101.0	92.5	-	-	175.0
053512-EMC	12-120	M120x2.0	20	-	-	101.0	109.0	92.5	-	-	175.0
053513-EMC	13-130	M130x2.0	20	-	-	109.0	119.0	92.5	-	-	175.0


All dimensions except NPT are in mm.

CCG reserves the right to make alterations to the technical data, dimensions, designs and products available without notice. The illustrations cannot be considered binding. Please contact CCG for assistance A2EMC-EMC010626E


A2 EMC COMPRESSION GLAND

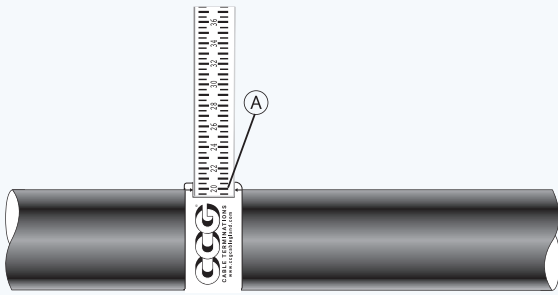


1. For accurate sizing, use a CCG Dimension Tape (A) on the outer cable sheath.

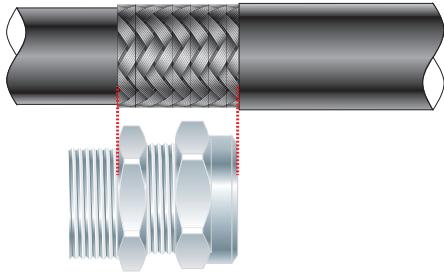


2. Cut back the cable outer sheath to expose the braid to a length not less than the gland assembly.

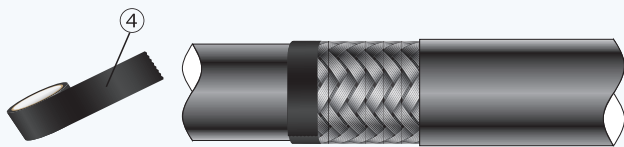

3. Using insulation tape (4), tape the braid on the inner sheath of the cable.

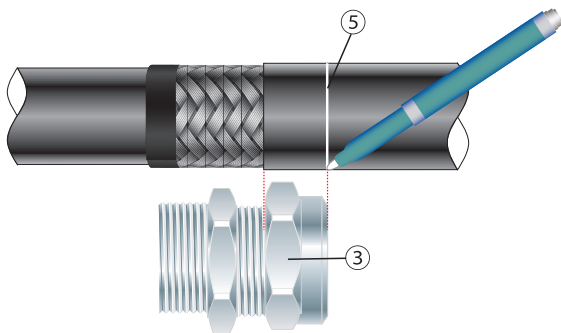


4. Measure the outer nut (3) on the outer sheath and mark (5) the outer sheath.

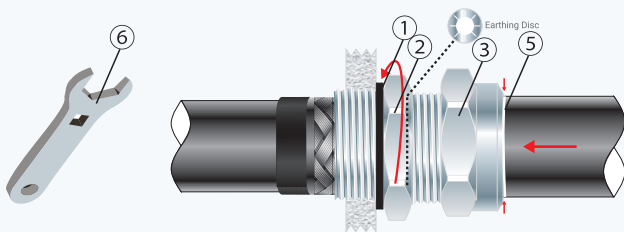


5. To maintain IP66/68, ensure the gasket (1) is in place. Screw the gland assembly into the apparatus. Pass the cable through the gland until the mark (5) on the outer sheath aligns with the outer nut (3) and the braid passes through the earth disk. Tighten the inner (2) to the installation torque using a CCG Spanner (6).

Alternative installation through an unthreaded entry.

If the apparatus is untapped use a locknut.



If the gland has NPT entry threads fitted to a threaded entry then IP68 (2m) can be achieved by applying one of the following tested and approved grease types to the thread:- Renolit Lubrene CA700 or LX220 EP2, Renolit LC-WP2 or Moly LX2, or Dow Corning 4 Electrical Compound.

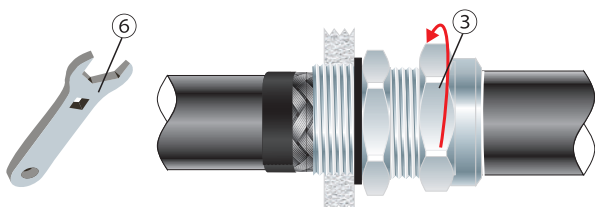

6. Tighten the outer (3) to the installation torque using a CCG Spanner (6).